




# Lot Electrical Service Equipment



The lot/park electrical service equipment has exposed or easily accessible live electrical parts. Cover all exposed live electrical parts and plug unused openings in electrical equipment. [25 CCR 1134(a), 1188(b); Reference: California Electrical Code, Article. 230-62]

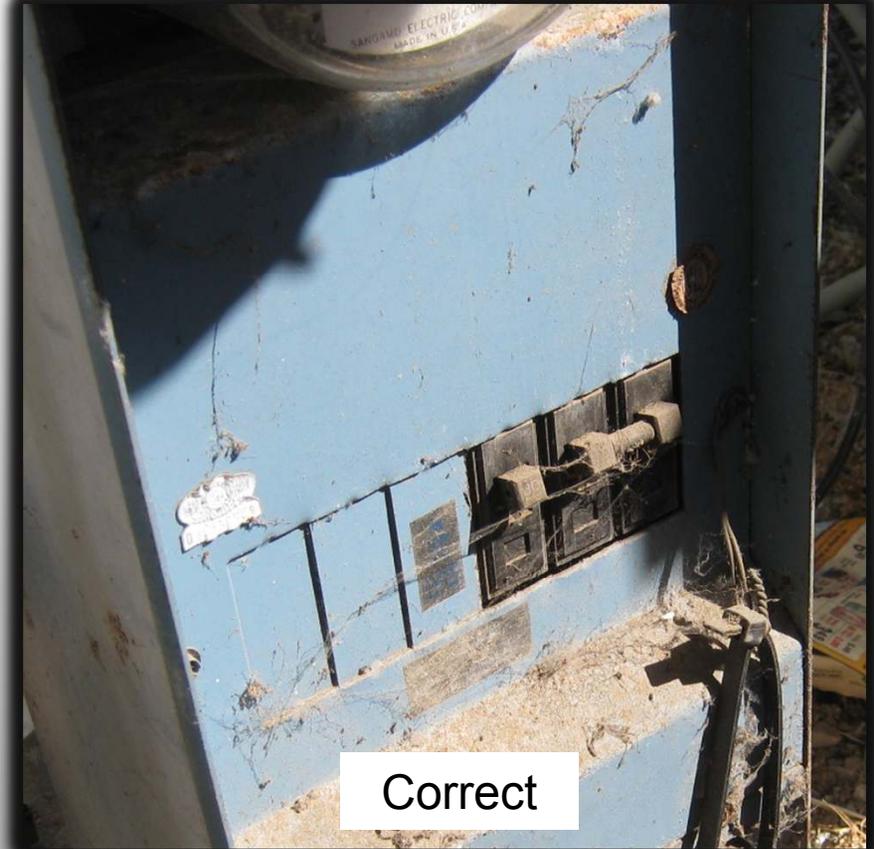

# Lot Electrical Service Equipment



The park/lot electrical service equipment is not accessible for inspection, repair, or disconnection in case of emergency. Provide unobstructed working clearance of at least 30 inches wide by 30 inches deep and 78 high in front of the electrical equipment. [25 CCR 1183; Reference: California Electrical Code, Article 110-26]