




Fire Control Room (top view)

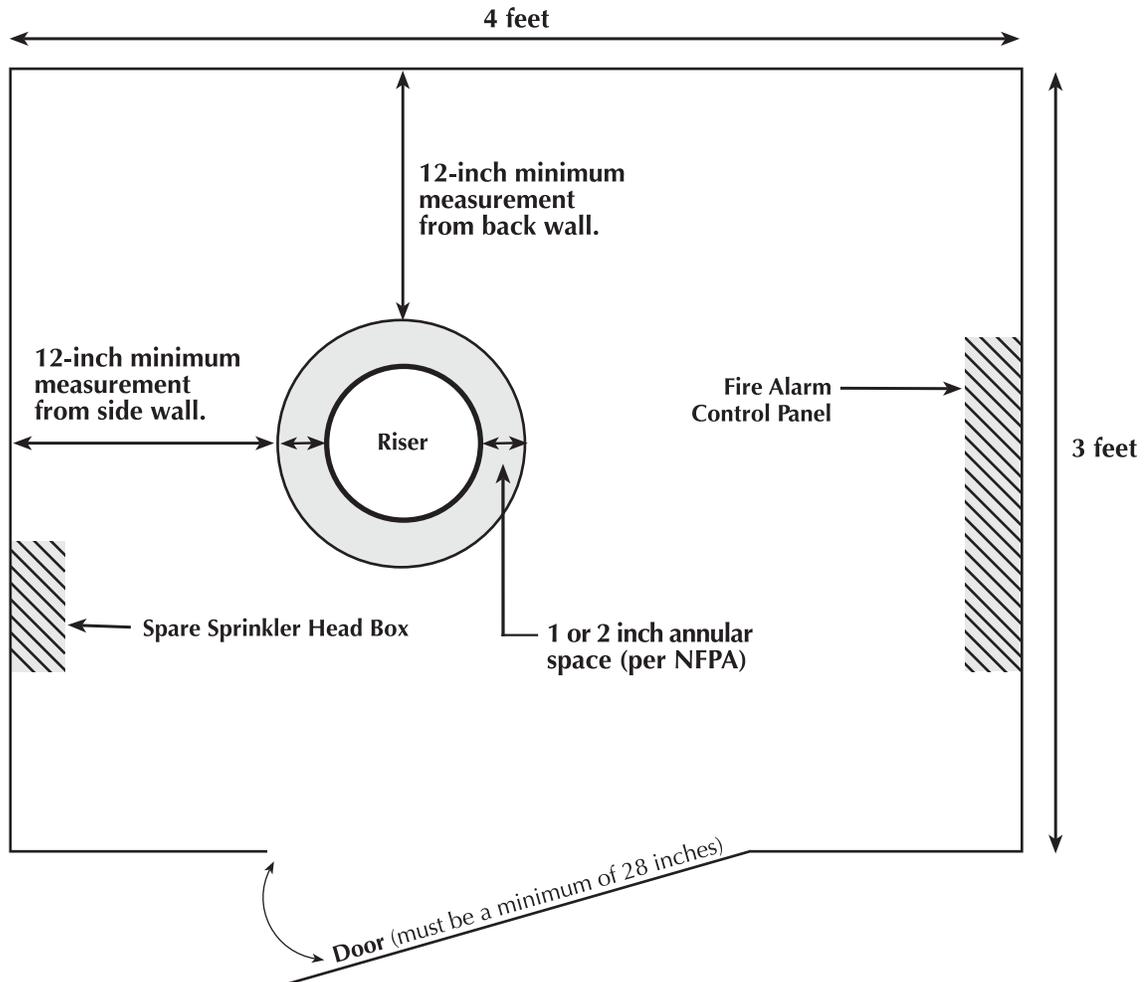

Fire Control Room Specifications

1. Measurements **MUST** be exact and will be subject to a field inspection.
2. Lighting is required on emergency back-up.
3. Door must be marked **"FIRE CONTROL ROOM"** in 4-inch letters.
4. Fire alarm panel to be located in the Fire Control Room.
5. A Fire Control Room shall be provided for each structure that has an automatic fire sprinkler system.
6. Doors shall exit directly to the exterior of the building and shall not be obstructed by any means.
7. This room shall not be used for any other purpose (i.e. no other non-life safety equipment can be located within this room).

*NOTE: For multiple risers in a room, the room dimension must be no less than 18 inches from appurtunances in all directions (to be approved by Fire Department.)