





Structure Setback Detail

TOP VIEW

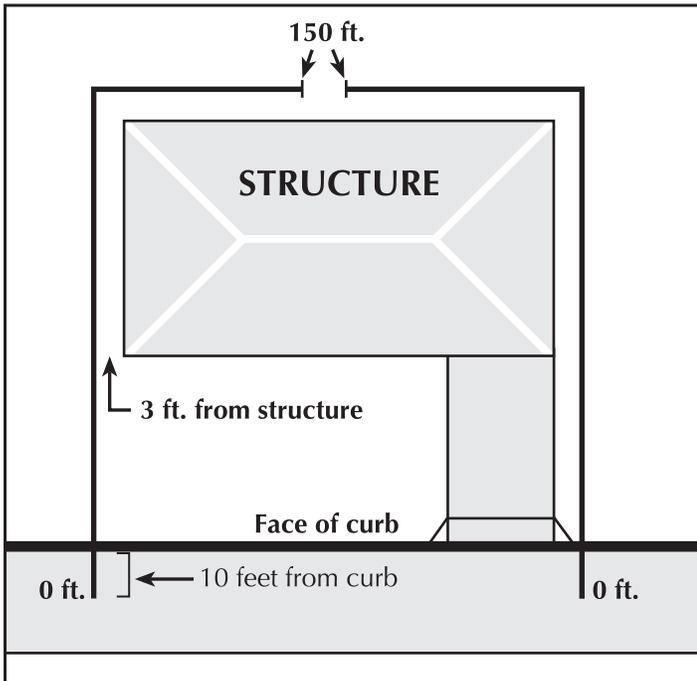

EXAMPLE 1: Structure with no grade change

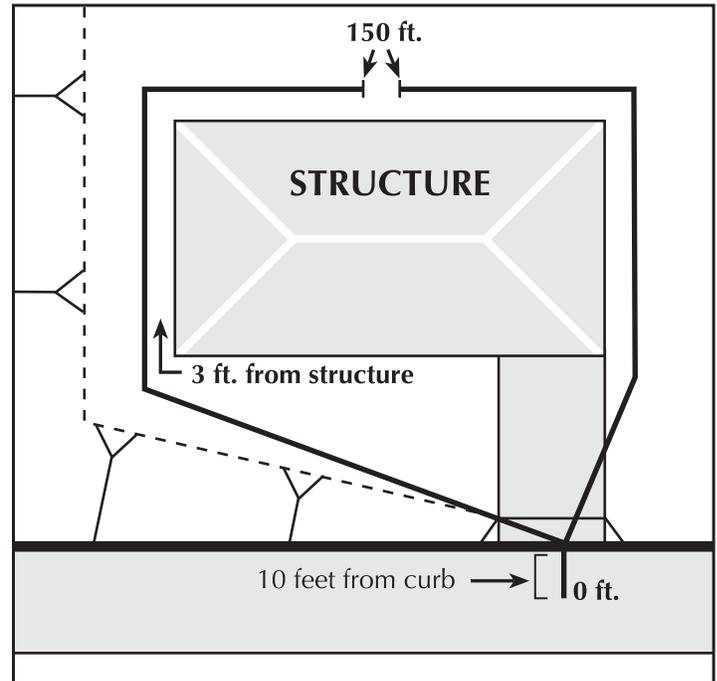

EXAMPLE 2: Structure with 25% slope

Notes:

1. Measurement starts 10 feet away from the curb on the street side.
2. The measurement shall stay beyond 3 feet of the structure.
3. The measurement shall end at 150 feet.
4. If any part of the structure is left uncovered (remote portion) then the structure shall be protected throughout by an approved fire sprinkler system.
5. In some circumstances (elevation changes) the starting point of both measurements shall be per example 2.
6. Please show measurements for all structures within the submittal scope.