





COMMERCIAL KNOX BOX/VAULT REQUIREMENTS

Multi-Tenant – For Buildings Equipped with a Fire Control Room

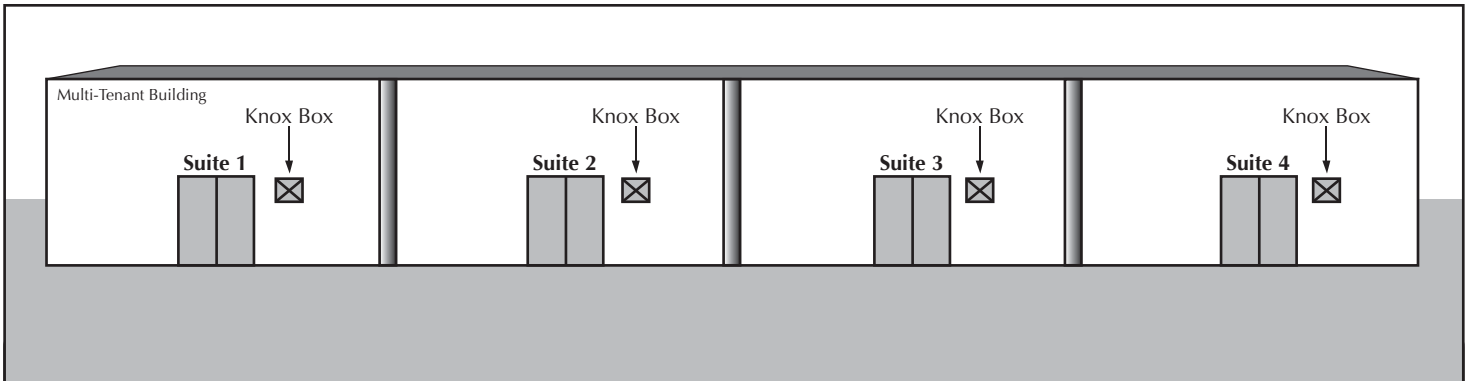

Main Entrance/Street Facing Side


- Located no further than 2 ft. from main entrance of each suite
- Minimum height = 5 ft. / Maximum = 6 ft.
- Knox Box model 3271 (recessed w/ hinged door)

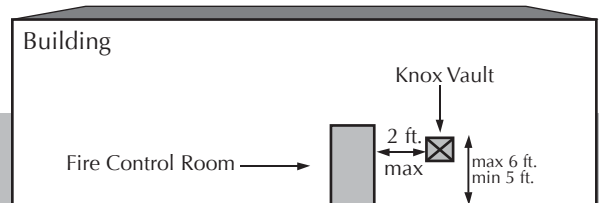

Fire Control Room

- Located no further than 2 ft. from Fire Control Room at latch side
- Minimum height = 5 ft. / Maximum = 6 ft.
- Knox Vault mode 4431 (recessed w/ hinged door)

- Multi-tenant commercial buildings are required to provide a Knox Box (model 3271) for each tenant space
- Buildings equipped with a Fire Control Room shall also provide a Knox Box (model 4431) at the Fire Control Room
- Some buildings will require additional Knox devices
- The “Fire Department” Alert Decal is to be mounted on the door or frame of the suite’s entrance
- Keys to be placed into the Knox box will be determined by CVFD Fire Prevention Staff (i.e. master key(s), FACP, SDG&E, keys for appliance operation, etc.)
- Required keys shall be secured in knox box/vault prior to final occupancy certification
- Knox devices can be ordered and purchased at www.knoxbox.com
- Install per manufacturers instructions

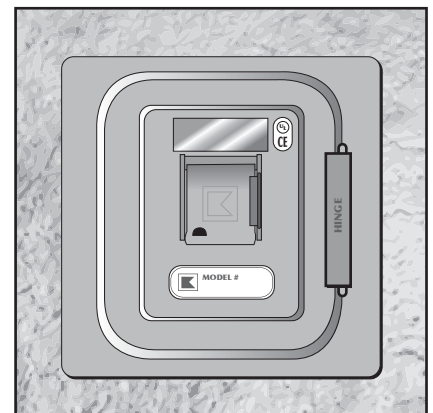

Knox Box/Vault