



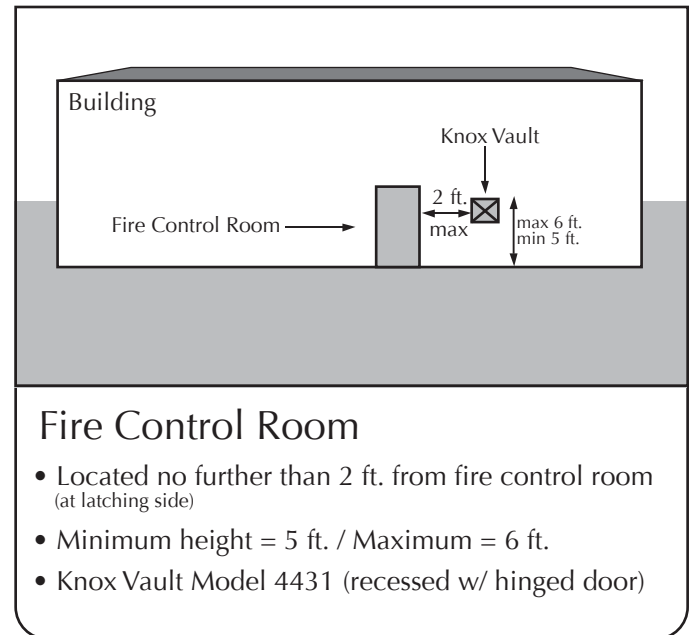


COMMERCIAL KNOX BOX/VAULT REQUIREMENTS

Single Tenant – For Buildings Equipped with a Fire Control Room

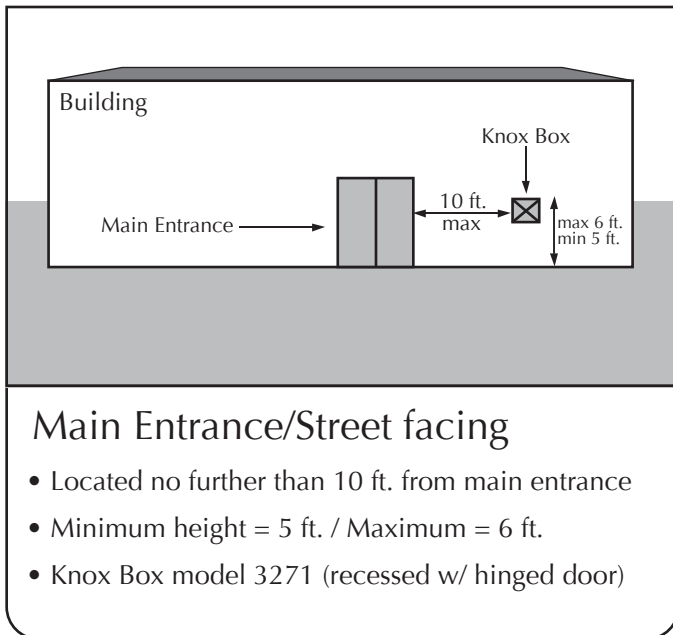

- Each building requires a minimum of two Knox devices (one Knox vault and one Knox box as indicated above). This requirement can only be waived by the Fire Marshal
- Some buildings will require additional Knox devices
- The “Fire Department” Alert Decal is to be mounted on the door or frame of the building’s main entrance
- Keys to be placed into the Knox box will be determined by CVFD Fire Prevention Staff (i.e. master key(s), Fire Control Room, FACP, SDG&E, keys for appliance operation, etc.)
- Required keys shall be secured in Knox box/vault prior to final occupancy certification
- Knox devices can be ordered and purchased at www.knoxbox.com
- Install per manufacturers instructions

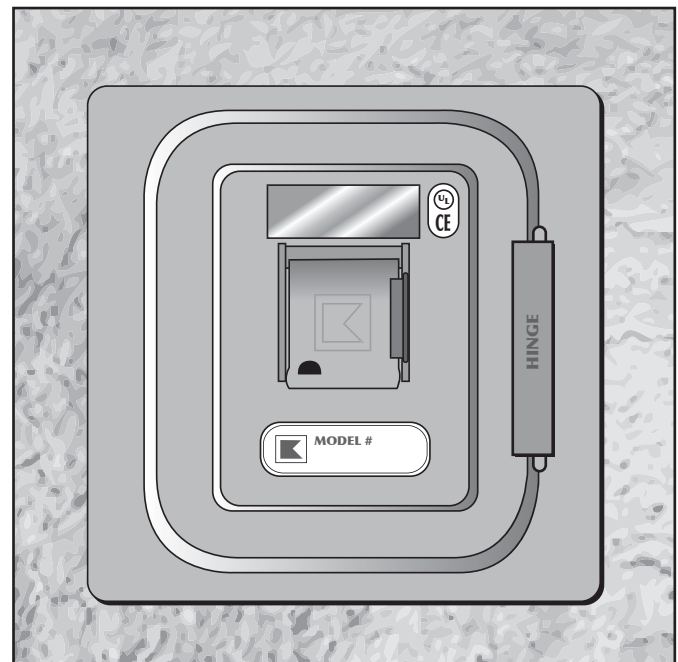

Knox Box/Vault